

TESTREPORT

(1. version)

job number: **70/1016/09**

client: **FunderMax GmbH**
Klagenfurter Straße 87-89
A – 9300 St. Veit/Glan

object: **determination of anti-slip properties in accordance to
DIN 51130 "workrooms and fields of activities with
raised slip danger; walking method – ramp test"**

sample: **MAX Compactplatten**
Hochdrucklaminat hpl nach EN 438

date of job: **20. July 2009**

date of samples
handed over: **30. July 2009**

pages: **2**

appendix: **1**



1. job

On 20. July 2009 three tiles of "MAX Compactplatten" within the dimensions of approximately 500 mm x 333 mm in accordance to the above mentioned job were handed over to Materialprüfungs- und Versuchsanstalt Neuwied. In accordance to the orderers information the tiles are named as mentioned above.

In accordance to the given mandate the above mentioned job should be carried out.

2. test and test results

2.1 determination of anti-slip properties in accordance to DIN 51 130

The determination of anti-slip properties was carried out in accordance to DIN 51 130: 2003-08 „Testing of floor coverings – determination of anti-slip properties; workrooms and fields of activities with raised slip danger; walking method – ramp test“. To carry out the tests each lot one model floor covering within the dimension of 500 mm x 1000 mm was prepared of the handed over tiles.

The determined average over all accepted degree of declination is 16,4°. The classification of the tested files is R10.

Neuwied, 30. July 2009/Ma/Ro/re

officer in charge

gez. Dipl.-Min. Henning Rohowski



director

(Dr. rer. nat. Karl-Uwe Voß)

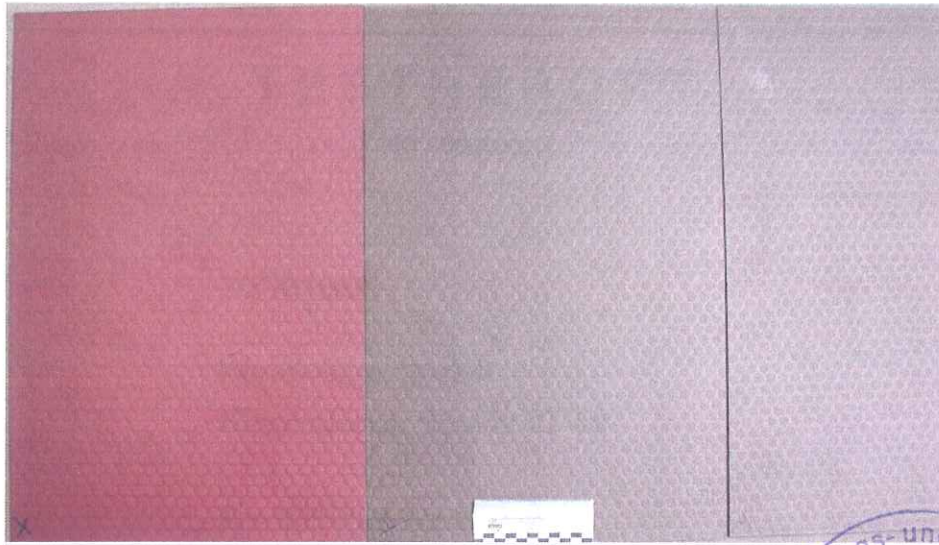


figure 1: ceramic tile named „MAX Compactplatte“

